




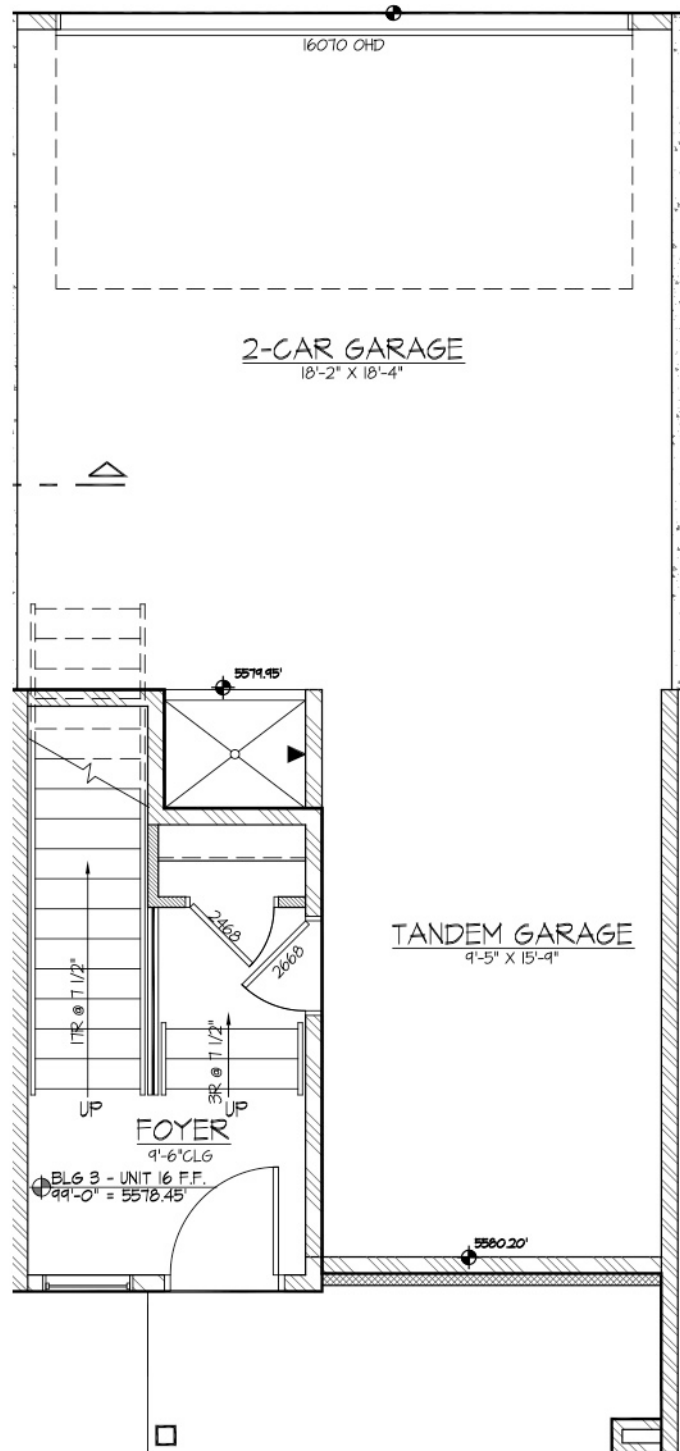

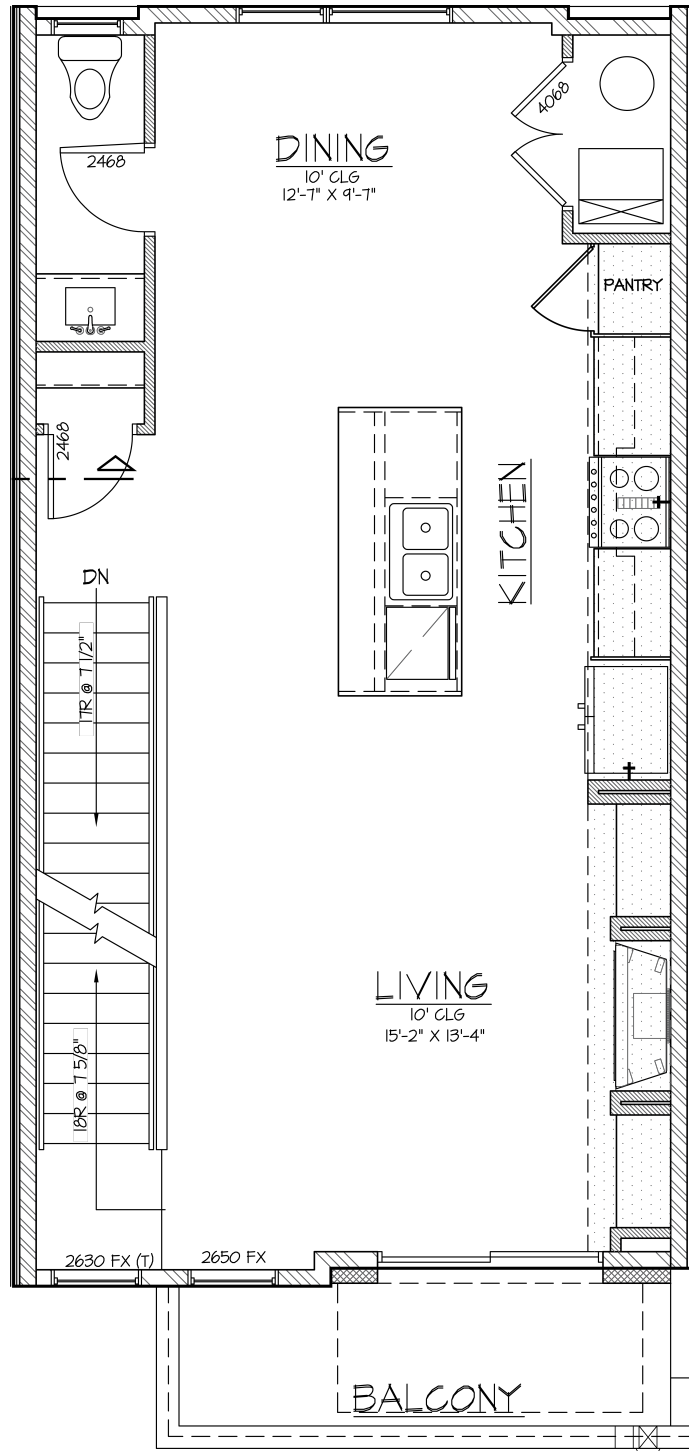

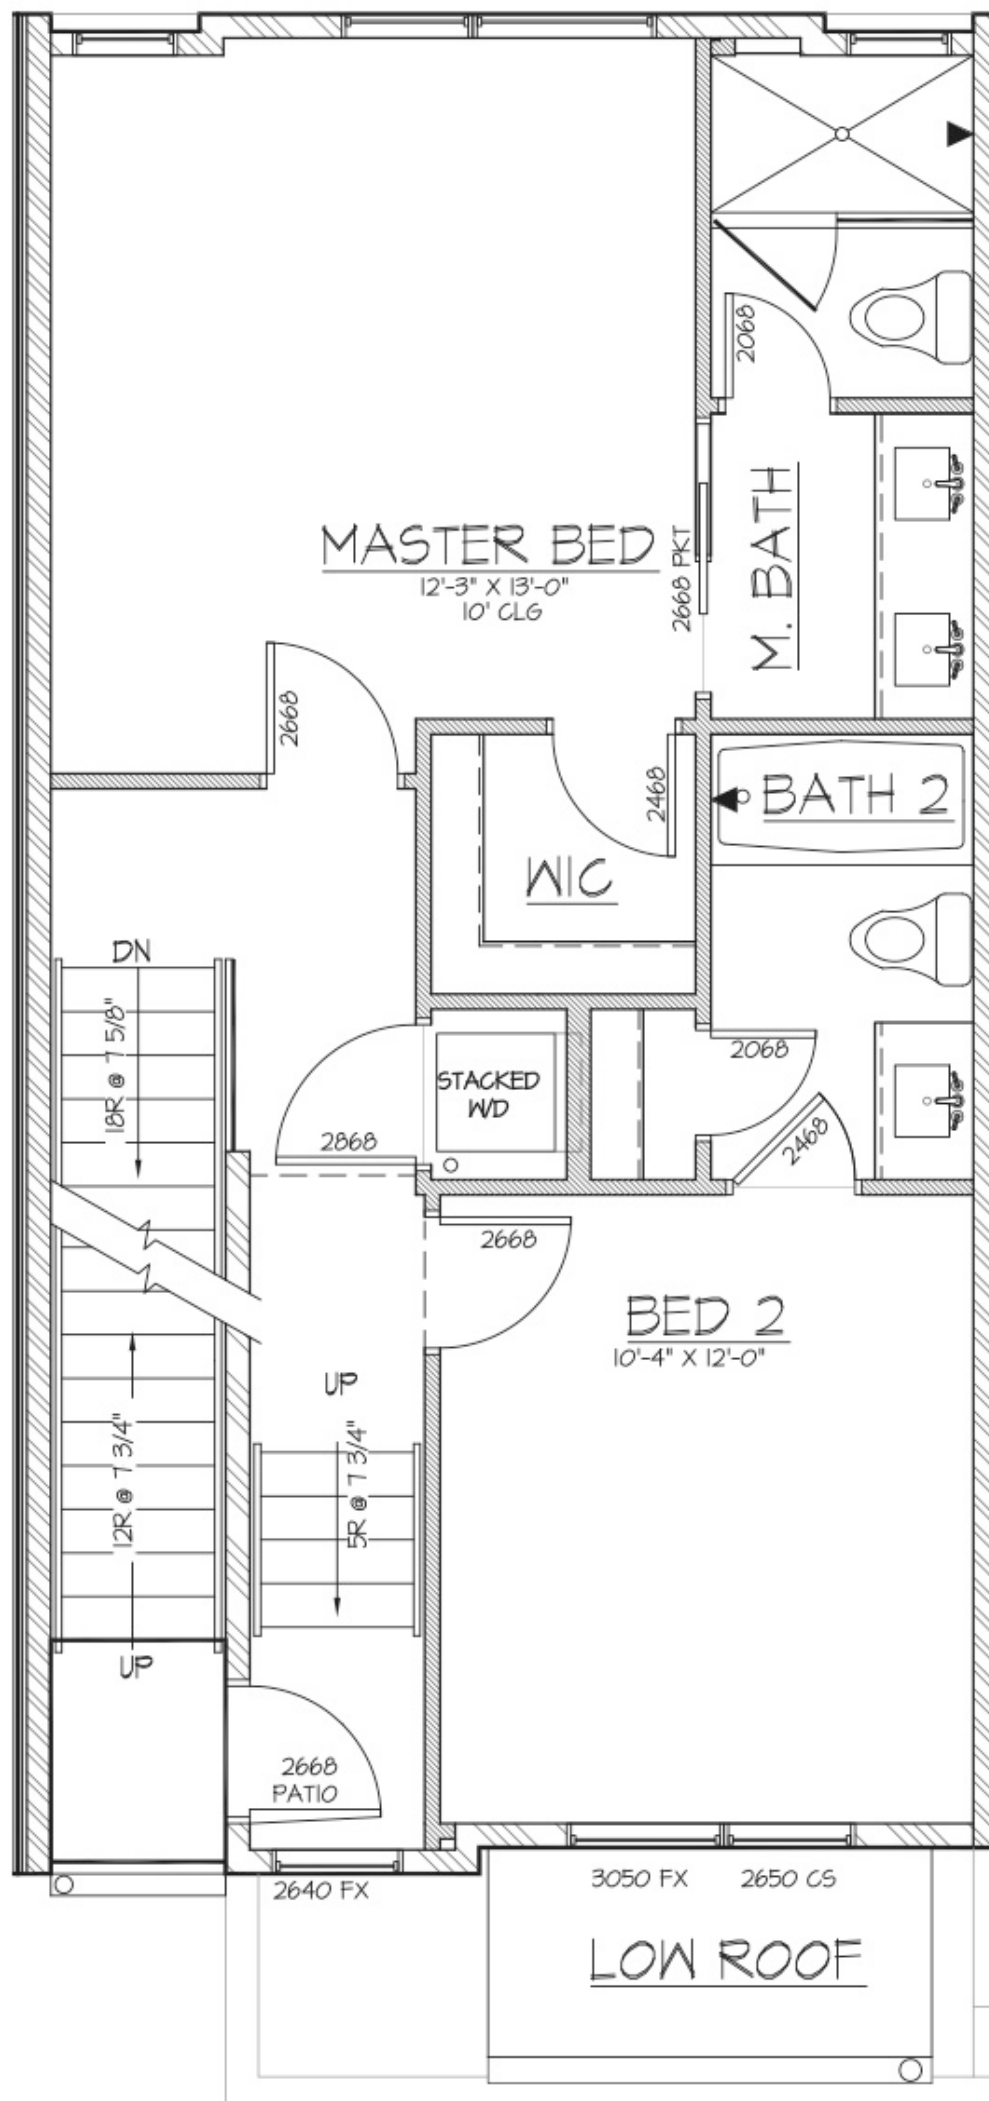

MASTER BED

12'-3" X 13'-0"
10' CLG

M. BATH

BATH 2

NIC

STACKED
WD

BED 2

10'-4" X 12'-0"

LOW ROOF

ROOF DECK

PROVIDE CONDUIT TO
ELECTRICAL SERVICE
PANEL FOR FUTURE SOLAR
PANEL INSTALLATION PER
2015 IECC RB103.6

DN

6" STEP

12R @ 7 3/4"

SOLAR
READY ZONE

